
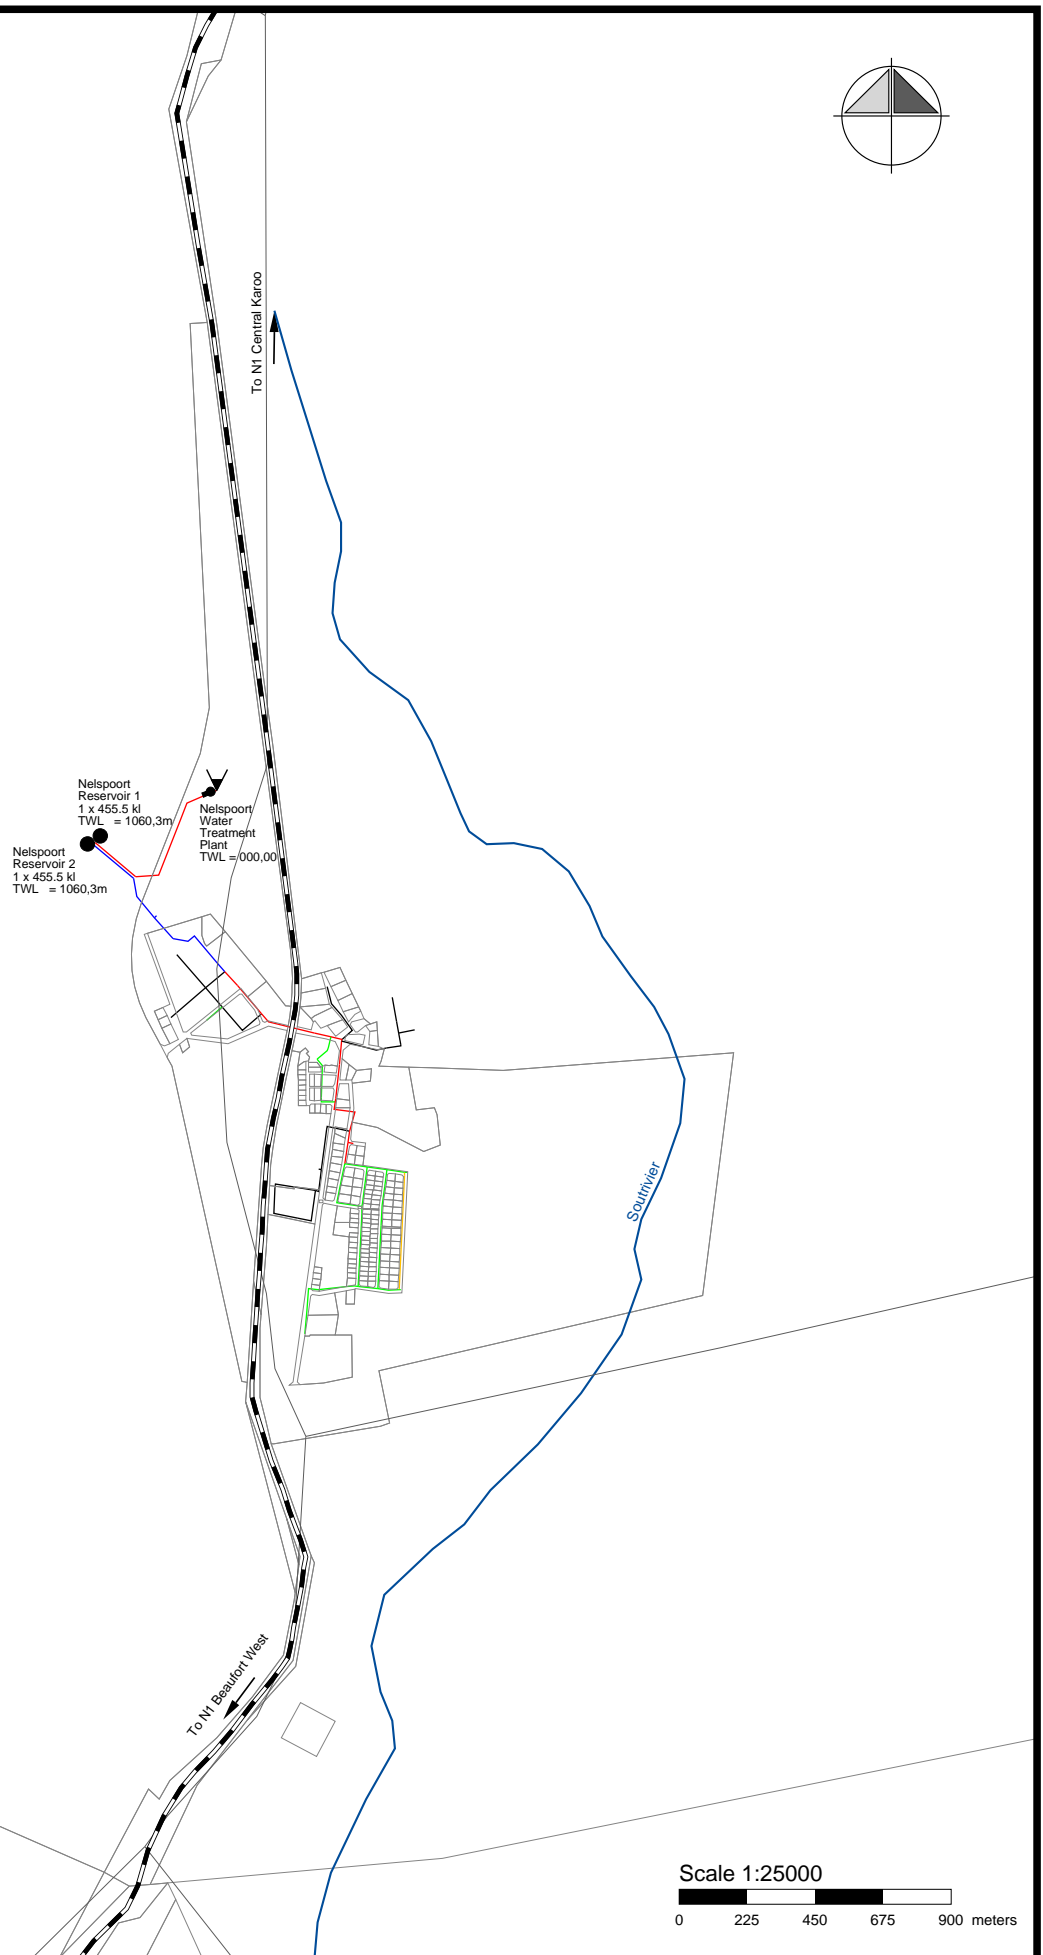


LEGEND

Pipe diameters

- ≤ 65
- > 65 ≤ 75
- > 75 ≤ 110
- > 110 ≤ 160
- > 160 ≤ 200
- > 200 ≤ 250
- > 250

- Reservoirs
- Pumping station
- Existing PRV
- Water Treatment Plant (WTP)
- Zone valve
- Non-return valve
- Railway line



November 2008

WATER MASTER PLAN BEAUFORT WEST

CEs

Figure BWW 2.1c

Nelspoort
Existing water system layout